



Toase-eh Park Sanati Gohar Ofogh  
Petrochemical Co.  
**CONCEPTUAL, BASIC and DETAIL DESIGN  
ENGINEERING OF STYRENE PARK OFFSITE**



Document Title: Chiller (Evaporator) Outline Drawing

Document No.: EI027-HSE-VD – ME– DWG– 008- R4

Rev. R4

Page 1 of 10

## STYRENE PARK OFFSITE

**Document Title:**

**Chiller (Evaporator) Outline Drawing**

R4	21-04-2025	FI	F.sh	M.O	A.M
R3	16-11-2024	IFA	F.sh	M.O	A.M
R2	16-09-2024	IFA	F.sh	M.O	A.M
R1	08-07-2024	IFA	F.sh	M.O	A.M
R0	15-05-2024	IFA	F.sh	M.O	A.M
<b>Rev.</b>	<b>Issued Date</b>	<b>DESCRIPTION</b>	<b>PREPARED</b>	<b>CHECKED</b>	<b>APPROVED</b>



Toase-eh Park Sanati Gohar Ofogh  
Petrochemical Co.  
**CONCEPTUAL, BASIC and DETAIL DESIGN  
ENGINEERING OF STYRENE PARK OFFSITE**



Document Title: Chiller (Evaporator) Outline Drawing


Document No.: EI027-HSE-VD – ME– DWG– 008- R4

Rev. R4

Page 2 of 10

**REVISION RECORD SHEET**

Page Page	Revisions							Page	Revisions						
	R0	R1	R2	R3	R4	R5	R6		R0	R1	R2	R3	R4	R5	R6
1	X	X	X	X	X			41							
2	X	X	X	X	X			42							
3	X	X	X	X	X			43							
4	X	X	X	X	X			44							
5	X	X	X	X	X			45							
6	X	X	X	X	X			46							
7	X	X	X	X	X			47							
8	X	X	X	X	X			48							
9	X	X	X	X	X			49							
10	X	X	X	X	X			50							
11								51							
12								52							
13								53							
14								54							
15								55							
16								56							
17								57							
18								58							
19								59							
20								60							
21								61							
22								62							
23								63							
24								64							
25								65							
26								66							
27								67							
28								68							
29								69							
30								70							
31								71							
32								72							
33								73							
34								74							
35								75							
36								76							
37								77							
38								78							
39								79							
40								80							

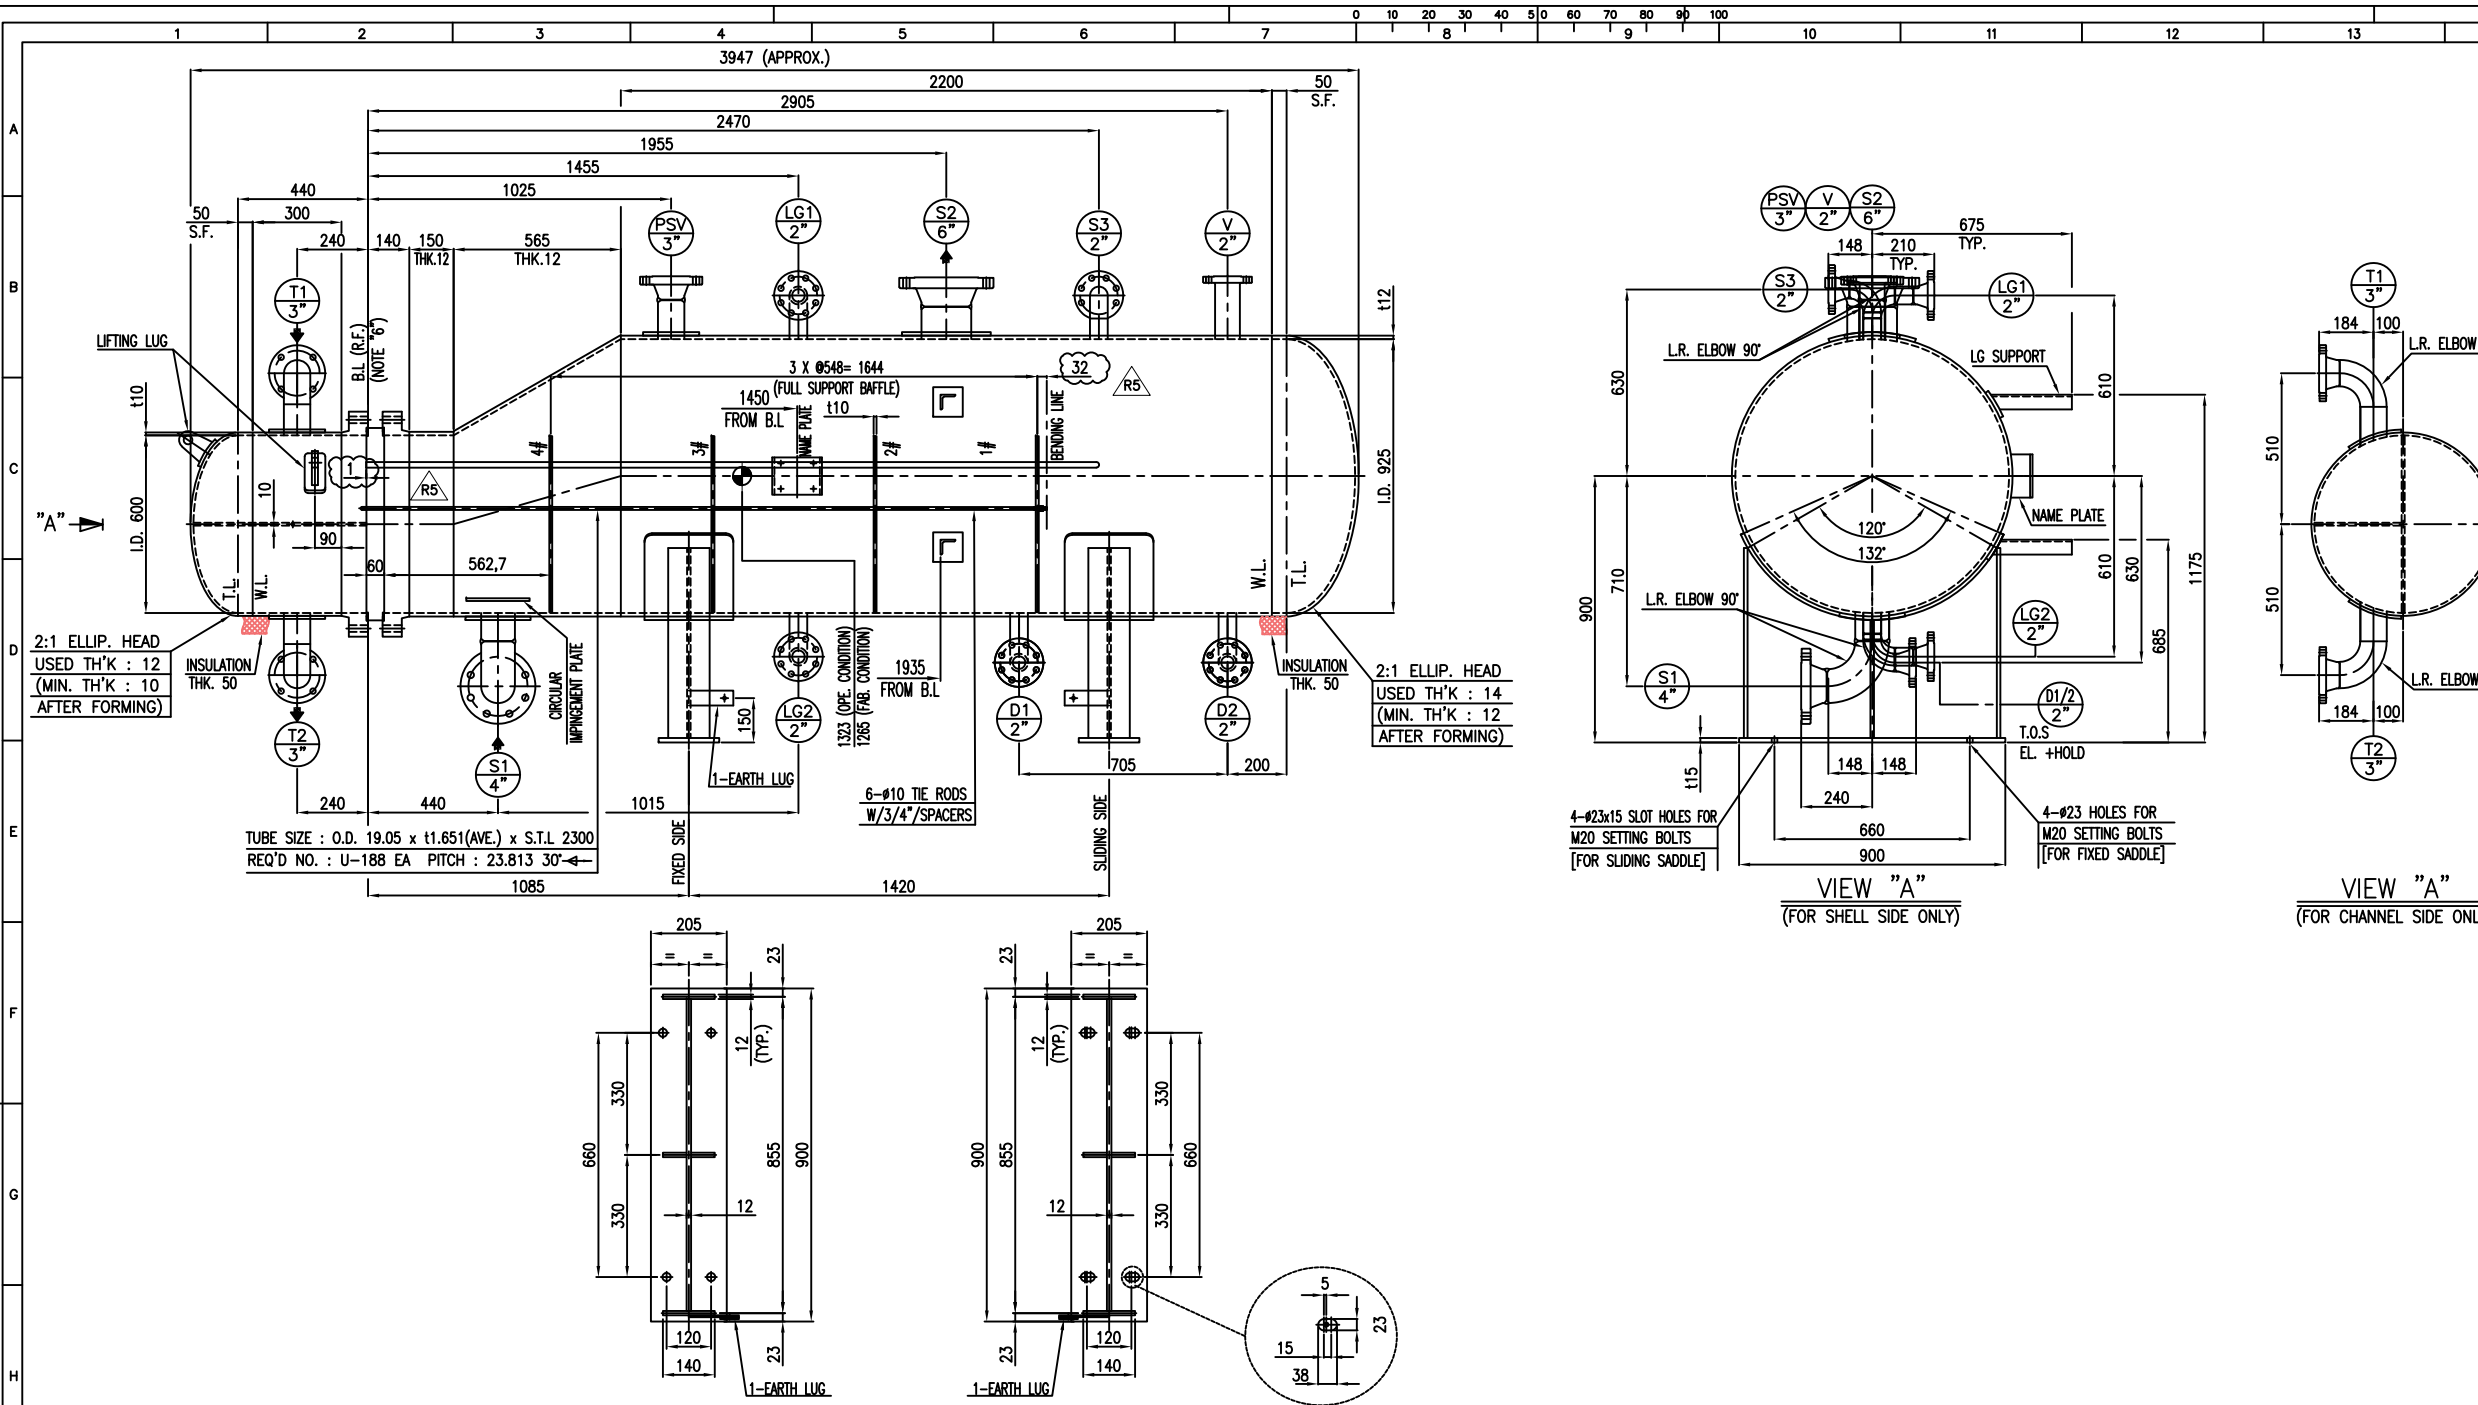

- NOTES**
- UNLESS OTHERWISE NOTED ALL DIMENSIONS ARE IN MILLIMETERS.
  - UNLESS OTHERWISE NOTED OUTSIDE PROJECTION OF NOZZLES ARE MEASURED FROM C.L. OF EXCHANGER TO THE EXTREME FACE OF NOZZLE.
  - ALL WELDS CONTINUOUS EXCEPT NOTED.
  - BOLT HOLES FOR FLANGES SHALL BE STRADDLED TO EQUIPMENT MAIN AXIS.
  - ALL R.F. FLANGES SHALL HAVE SMOOTH FINISH FACING WITH RA= 3.2mm TO RA= 6.3mm.
  - BASE LINE (B.L.) INDICATES THE GASKET CONTACT SURFACE OF TUBE SHEET.
  - REINFORCING PADS FOR NOZZLES SHALL BE TAPPED WITH AT LEAST ONE (1) TELL TALE HOLE NPT 1/4" WITH VENT PIPE.
- 
- DIMENSIONS REFER TO BAFFLES ARE MEASURED FROM C.L.OF EACH PLATE.
  - GASKET MATERIAL FOR ASME B16.20. SPIRAL WOUND (t4.5)
    - FILLER: GRAPHITE
    - INNER RING: 304 S.S.
    - OUTER RING: 304 S.S.
  - GASKET MATERIAL: SPIRAL WOUND (t4.5)
    - FILLER: GRAPHITE
    - INNER RING: 304 S.S.
    - HOOP: 304 S.S.
  - SPARE PART (OPTIONAL)
- | CONSTRUCTION & COMMISSIONING |                 |
|------------------------------|-----------------|
| GASKETS                      | 100%            |
| STUD BOLTS & NUTS            | 5% (MIN. 2SETS) |
- ALL EXPOSED SURFACE SHALL BE PAINTED AS FOLLOWS: EXPOSED SURFACE FOR EXTERNAL PARTS: EIO27-HSE-VD-QC-PRO-002 EXPOSED SURFACE OF INTERNAL: NOT PARTS REQUIRED
  - 1/1.4 FACTOR FOR LOAD COMBINATION HAS BEEN APPLIED
  - TUBES SHALL BE SEAMLESS
  - GASKET CONTACT SURFACE OF TUBE SHEET & GIRTH FLANGE: RA= 1.6µm (MAX)
  - FURTHER DETAILS TO BE ADDED FOR DISCLAIMER PURPOSES SUCH AS AFTER HYDROTEST TO BE CLEANED AND DRIED.

**TABLE FOR FOUNDATION LOAD DATA**

WIND		SEISMIC (NOTE 13)	
SHEAR (kgf)	MOMENT (kgf-m)	SHEAR (kgf)	MOMENT (kgf-m)
478	430	970	873

**MATERIALS**

	SHELL	GENERAL
BARREL	SA516-70N	SLIDING BAR/ROD SA516 70/SA36
FLANGES	SA350-LF2 CL.1N	SEALING STRIP SA516 70
NOZZLE FROM PIPE	SA333-6	DUMMY TUBE/SEAL ROD -
NOZZLE FROM PLATE	SA516-70N	BLINDED NOZZLE BOLT/NUT SA320 L7/SA194-4
NOZZLE FLANGES	SA350-LF2 CL.1N	BLINDED NOZZLE GASKET SEE NOTE "9"
COUPLINGS & PLUGS	-	TEST RING SA-266 2
NOZZLE REINF. PAD	SA516-70N	GASKETS
EXCHANGERS SUPPORTS	SA283-C	SHELL/COVER -
SUPPORT WEAR PLATE	SA516-70N	SHELL/TUBESHEET SEE NOTE "10"
STIFFENING RINGS	SA516-70N	CHANNEL/TUBESHEET SEE NOTE "10"
EXPANSION JOINT	-	CHANNEL/COVER -
LINING	-	FLOATING HEAD -
<b>SHELL COVER</b>		
BARREL	-	COVER -
COVER	-	FLANGES -
FLANGES	-	SPLIT RING -
<b>CHANNEL</b>		
BARREL	SA516-70N	SHELL/COVER -
FLANGES	SA266-2N	SHELL/CHANNEL SA320-L7/SA194-4
COVER	SA516-70N	CHANNEL/COVER -
FLAT COVER	-	FLOATING HEAD -
NOZZLE FROM PIPE	SA106-B	SETTING BOLTS/NUTS SA193 B7 / SA194 2H
NOZZLE REINF.	SA516-70N	TUBE BUNDLE
NOZZLE FLANGES	SA105N	TUBES SA334-6
COUPLINGS & PLUGS	-	TUBESHEETS SA350-LF2 CL.1N
NOZZLE REINF. PAD	SA516-70N	BAFFLES/SUPPORTS/IMP. PLATE SA516-70
PARTITION PLATES	SA516-70N	TIE RODS & SPACERS SA36/SA179

**DESIGN DATA**

CODE	ASME SEC. VIII DIV.1 (2021 ED.)	TYPE	H-BKU
TEMA CLASS	TEMA 10TH ED. (CLASS "R")	CODE STAMP	NO
LOCAL REGULATION	NO	WIND / SEISMIC CODE	UBC 97
FLUID	PROPANE	STYRENE	WIND EXPOSURE / VELOCITY (km/h) D / 125
DESIGN (INT.EXT.)	PRESS. barg 22/F.V. 6.8	Ca/Cv/Nv	0.4/0.56/1
TEMP. (°C)	120/85	SEISMIC IMPROVANCE FACTOR/RESPONSE FACTOR	1.25 / 3
STEAM OUT CONDITION	-	INSULATION (TYPE/THK.)	COLD/50 COLD/50
OPER. (IN/OUT)	PRESS. barg 3.813	FIRE PROOFING (mm)	-
TEMP. (°C)	1.24/1	PAINTING	SEE NOTE "12"
CORROSION ALLOWANCE (mm)	3	TUBE TO TUBESHEET JOINT	NEW EXPOSED WITH 2 OR MORE NEW SEAL RING
JOINT EFFICIENCY (S/H)	1.0/1.0	NO. OF PASS	1(ONE) 4(FOUR)
RADIOGRAPHY (S/H)	FULL/FULL	BUNDLE (KG)	840
HYDRO. TEST PRESS. (SHOP/FIELD)	barg 28.6/28.6	ERECTION (KG)	2,850
HYDRO. TEST TYPE	(U-900) NOTE (2) (U-900) NOTE (3)	EMPTY (KG)	2,850
PNEUM. TEST PRESS. barg	-	OPER. (KG)	4,250
M.D.M.T. (°C)	-45	FULL WATER (KG)	4,900
MAWP (HOT & CORRODED) barg	22	SURFACE AREA/SHELL (M²)	61.76
M.A.P. (NEW & COLD) barg	22	VOLUME (M³)	1.65 0.38
P.W.H.T.	NO	FLUID DENSITY (kg/m³)	532.9 918.4
IMPACT TEST	NO	MEAN METAL TEMP. (°C)	-
S.R. OF HEAD AFTER COLD FORMING	YES		SHELL SIDE/TUBE SIDE


**NOZZLE LIST**

NOZZLE MARK	Q'TY	SIZE (INCH)	FLANGE RATING	SCH.	SERVICE	H/EX. C.L. PROJECTION	REINF. PAD TH'K	O.D.
S1	1	4"	ASME B16.5 300# WNRF	120	SHELL SIDE INLET	SEE DWG.	12	220
S2	1	6"	ASME B16.5 300# WNRF	80	SHELL SIDE OUTLET	SEE DWG.	12	300
T1	1	3"	ASME B16.5 150# WNRF	80	CHANNEL SIDE INLET	SEE DWG.	10	190
T2	1	3"	ASME B16.5 150# WNRF	80	CHANNEL SIDE OUTLET	SEE DWG.	10	190
D1	1	2"	ASME B16.5 300# LWNRF	160	SHELL SIDE DRAIN	SEE DWG.	-	-
D2	1	2"	ASME B16.5 300# LWNRF	160	OIL RECOVERY	SEE DWG.	-	-
LG1	1	2"	ASME B16.5 300# WNRF	160	LEVEL GAUGE	SEE DWG.	-	-
LG2	1	2"	ASME B16.5 300# WNRF	160	LEVEL GAUGE	SEE DWG.	-	-
PSV	1	3"	ASME B16.5 300# WNRF	160	PRESSURE SAFETY VALVE	675	12	190
V	1	2"	ASME B16.5 300# LWNRF	t16.6	VENT	675	-	-
S3	1	2"	ASME B16.5 300# WNRF	160	SHELL SPARE/PURGE	SEE DWG.	-	-

**LEGEND**

B.L. = BASE LINE  
 C.L. = CENTER LINE  
 M.D.M.T. = MIN. DESIGN METAL TEMPERATURE  
 N. = NORMALIZED  
 O.T.L. = OUTER TUBE LINE  
 C.O.G. = CENTER OF GRAVITY  
 T.O.G. = TOP OF GROUTING  
 W.P. = WORKING POINT

REFERENCE DRAWING	DWG NO.	REV.
-	-	-

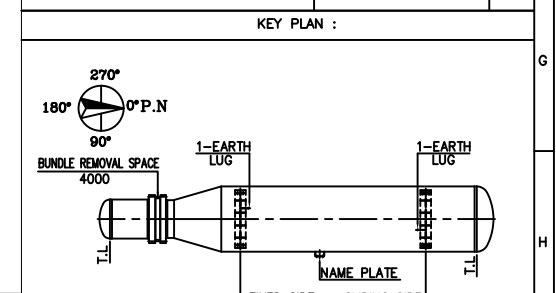

REV.	ISSUE DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED
R5	04.20.2025	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R4	11.10.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R3	09.14.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R2	07.21.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R1	06.27.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R0	04.21.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.

CLIENT




پارس پتروشیمی توسعه پارک  
 صنعتی گوهر اقیانوس

CONSULTING ENGINEER

PROJECT: **STYRENE PARK OFFSITE**

DRAWING TITLE: **GENERAL ARRANGEMENT DRAWING FOR CHILLER (EVAPORATOR)**

DRAWING NO.	REV.	SIZE	SCALE	SHEET
EIO27-HSE-VD-ME-DWG-008	R5	A3	NTC	1 of 8

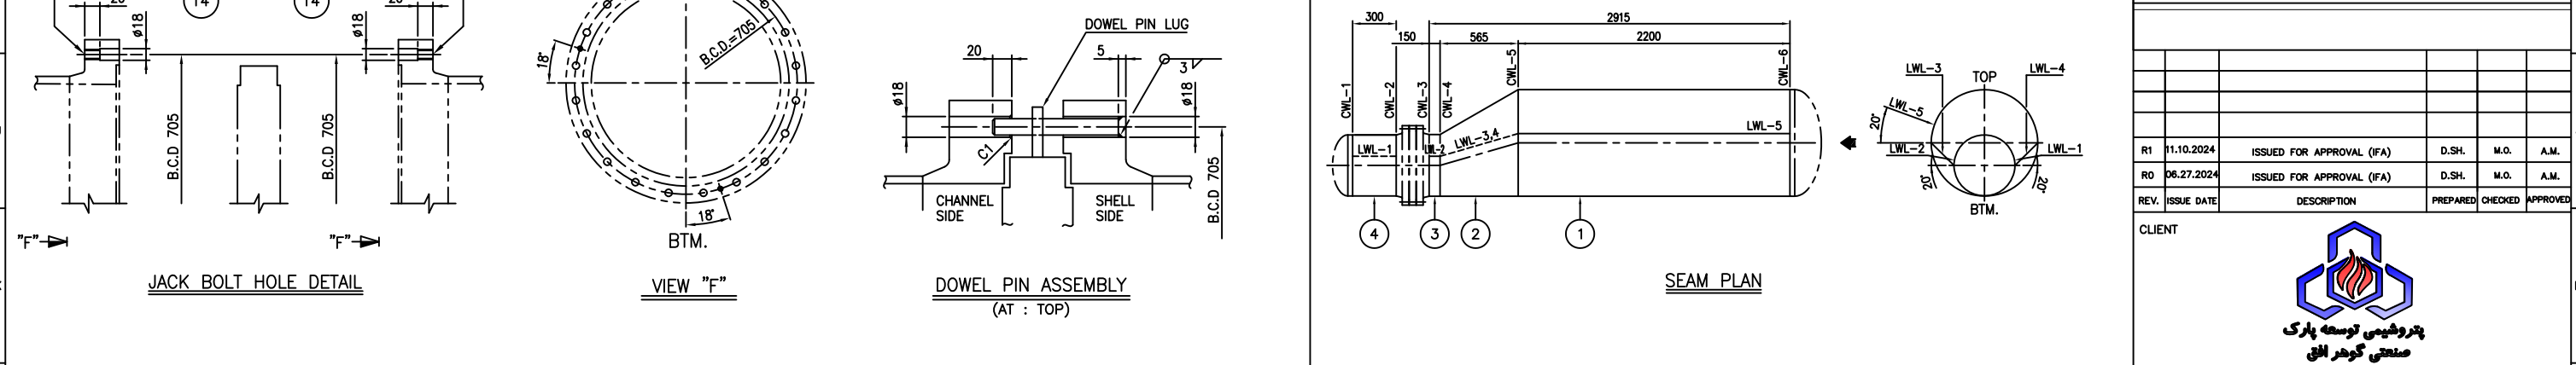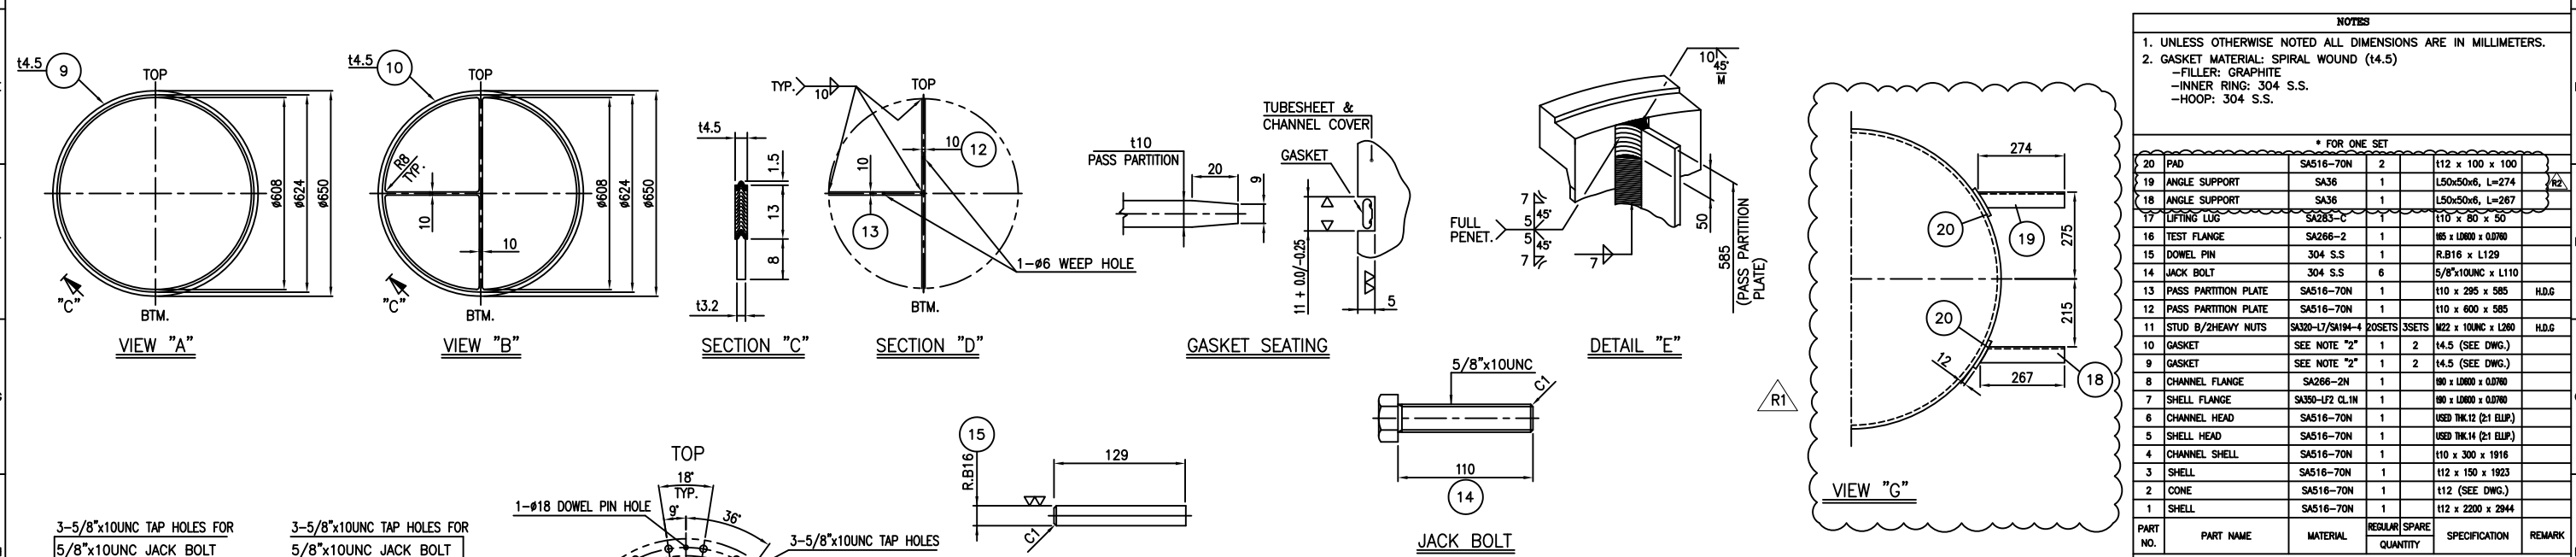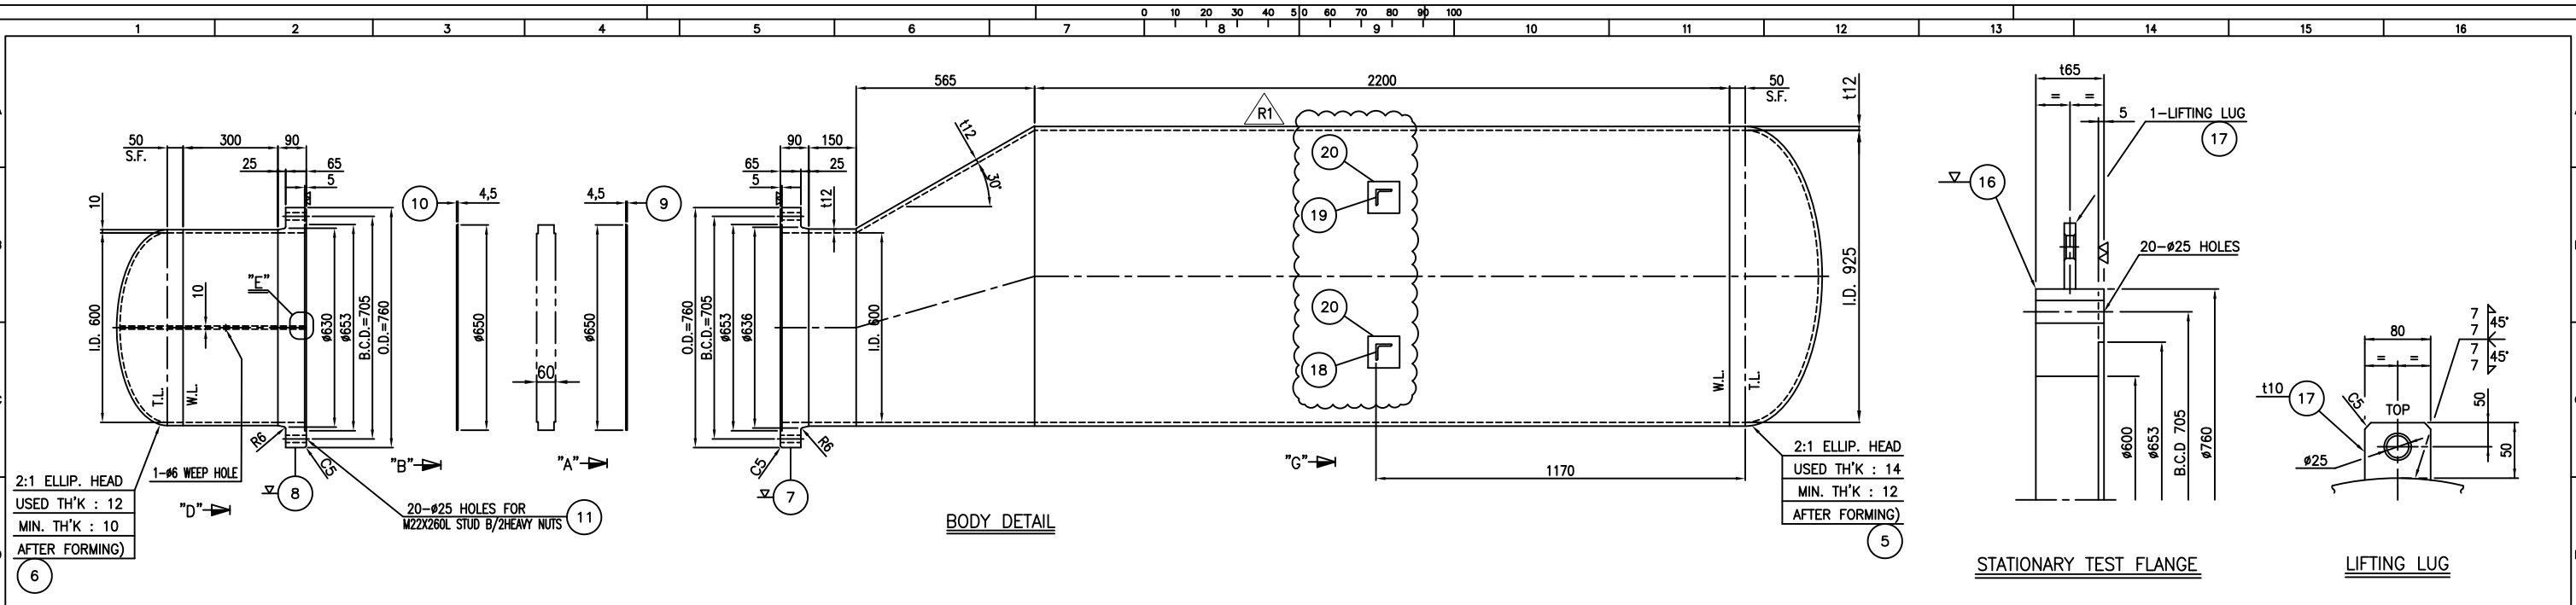

**NOTES**

- UNLESS OTHERWISE NOTED ALL DIMENSIONS ARE IN MILLIMETERS.
- GASKET MATERIAL: SPIRAL WOUND (14.5)  
-FILLER: GRAPHITE  
-INNER RING: 304 S.S.  
-HOOP: 304 S.S.

\* FOR ONE SET

PART NO.	PART NAME	MATERIAL	REGULAR QUANTITY	SPARE QUANTITY	SPECIFICATION	REMARK
20	PAD	SA516-70N	2		t12 x 100 x 100	
19	ANGLE SUPPORT	SA36	1		L50x50x6, L=274	
18	ANGLE SUPPORT	SA36	1		L50x50x6, L=267	
17	LIFTING LUG	SA285-C	1		t10 x 60 x 50	
16	TEST FLANGE	SA286-2	1		85 x L800 x 0.8780	
15	DOWEL PIN	304 S.S.	1		R.B16 x L129	
14	JACK BOLT	304 S.S.	6		5/8"x10UNC x L110	
13	PASS PARTITION PLATE	SA516-70N	1		t10 x 295 x 585	H.D.G.
12	PASS PARTITION PLATE	SA516-70N	1		t10 x 600 x 585	
11	STUD B/2HEAVY NUTS	SA320-L7/SA194-4	20SETS	3SETS	M22 x 100NC x L260	H.D.G.
10	GASKET	SEE NOTE "2"	1	2	t4.5 (SEE DWG.)	
9	GASKET	SEE NOTE "2"	1	2	t4.5 (SEE DWG.)	
8	CHANNEL FLANGE	SA286-2N	1		80 x L800 x 0.8780	
7	SHELL FLANGE	SA350-LF2 CL.IN	1		80 x L800 x 0.8780	
6	CHANNEL HEAD	SA516-70N	1		USED THK.12 (2:1 ELLIP.)	
5	SHELL HEAD	SA516-70N	1		USED THK.14 (2:1 ELLIP.)	
4	CHANNEL SHELL	SA516-70N	1		t10 x 300 x 1916	
3	SHELL	SA516-70N	1		t12 x 150 x 1923	
2	CONE	SA516-70N	1		t12 (SEE DWG.)	
1	SHELL	SA516-70N	1		t12 x 2200 x 2944	

**BILL OF MATERIAL**

REV.	ISSUE DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED
R1	11.10.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
RO	06.27.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.




CLIENT










CONSULTING ENGINEER

PROJECT: **STYRENE PARK OFFSITE**

DRAWING TITLE: **BODY DETAIL DRAWING FOR CHILLER (EVAPORATOR)**

DRAWING NO.	REV.	SIZE	SCALE	SHEET
EIO27-HSE-VD-ME-DWG-008	R2	A3	NTC	2 of 8

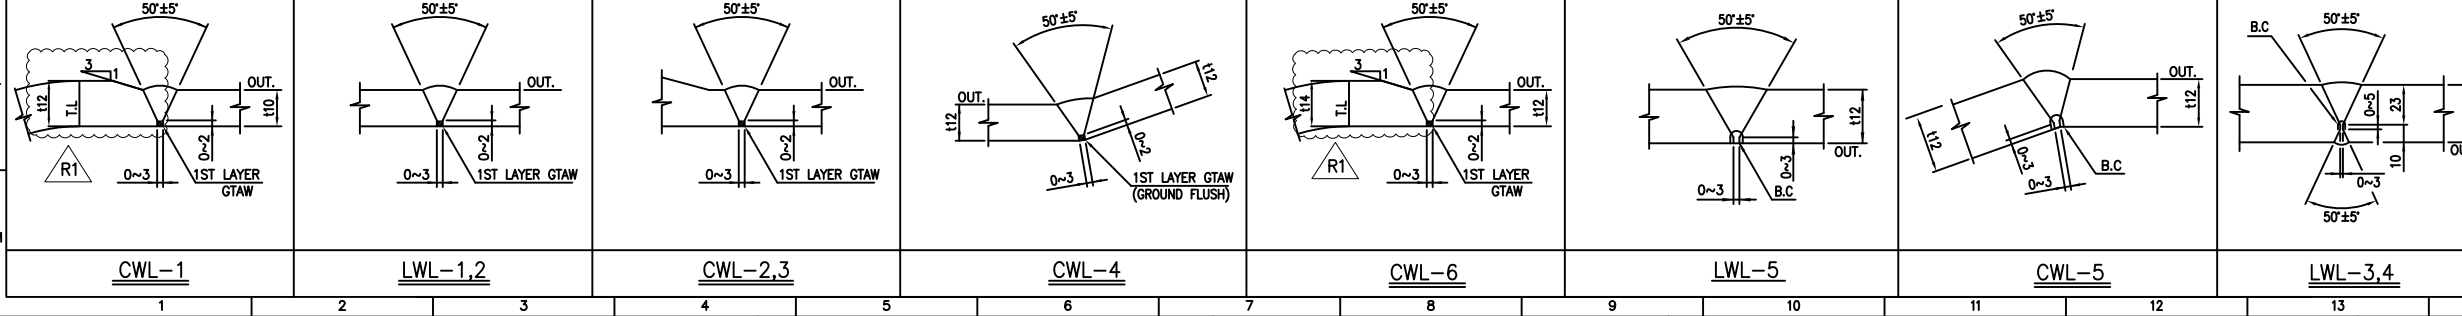

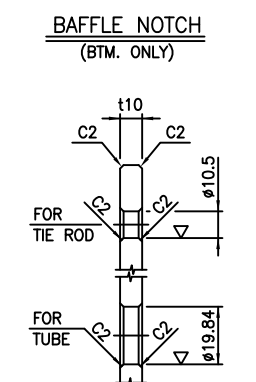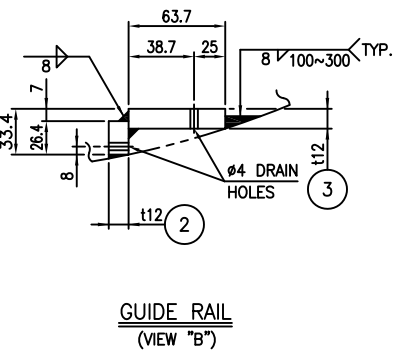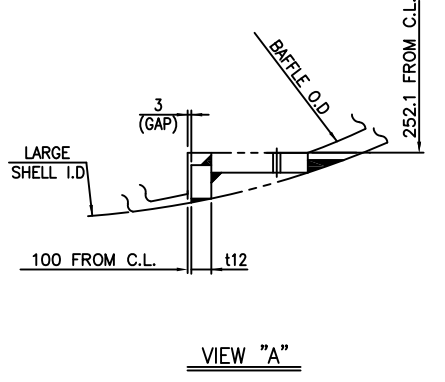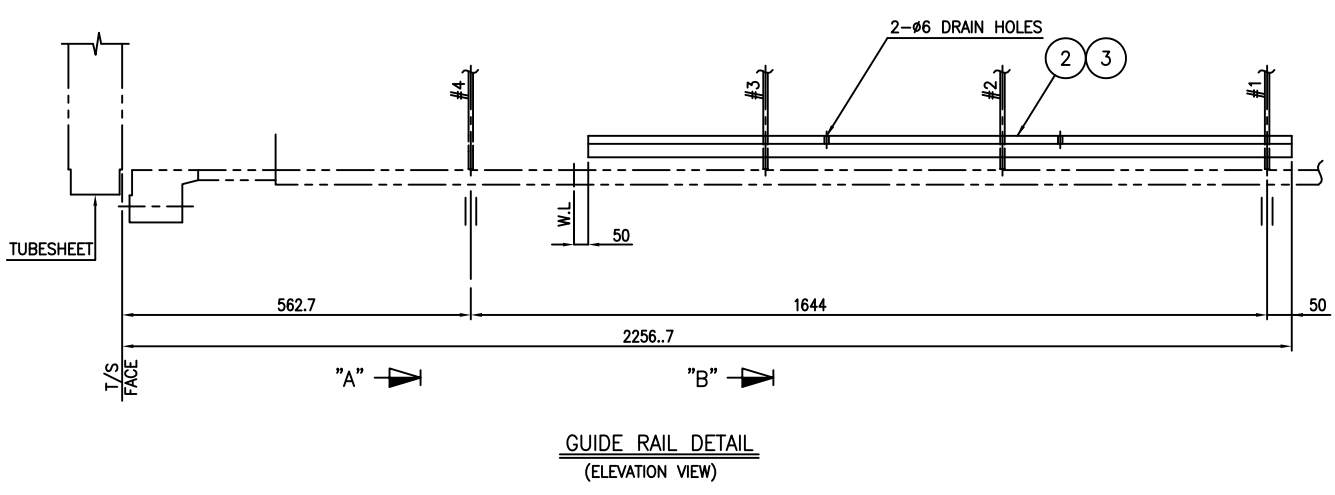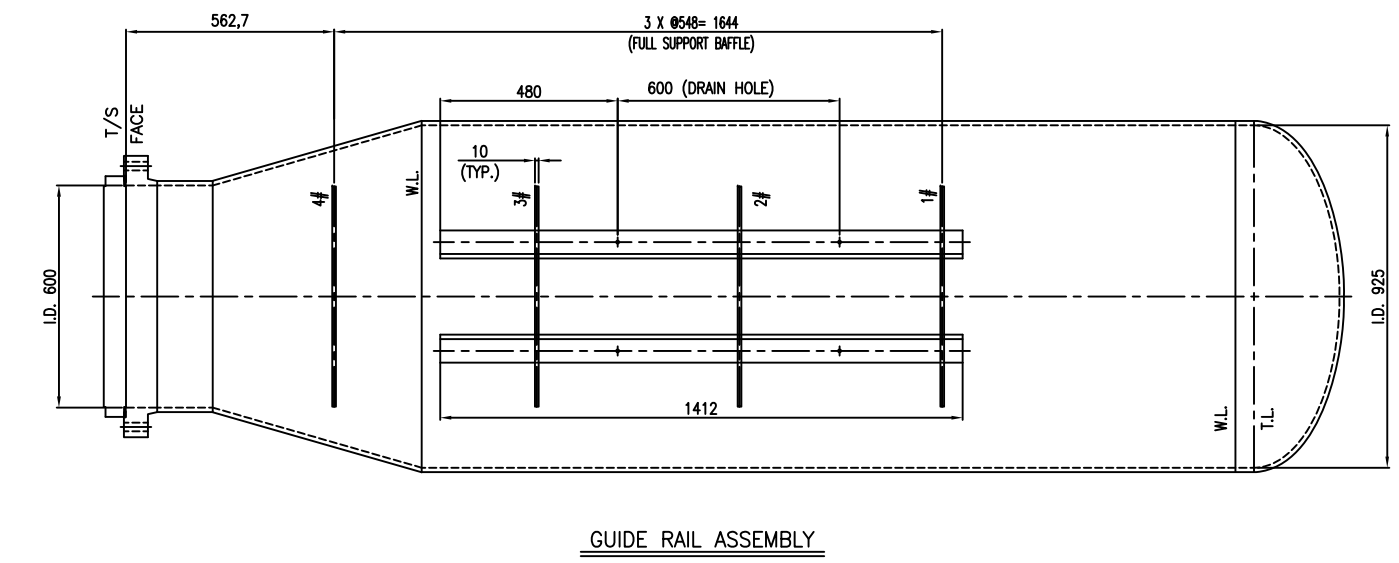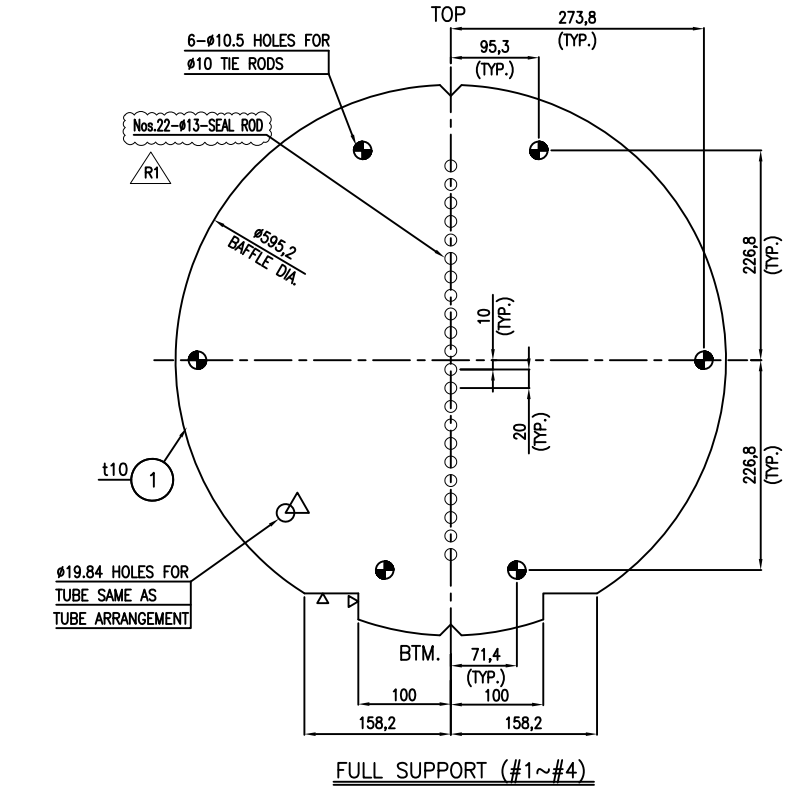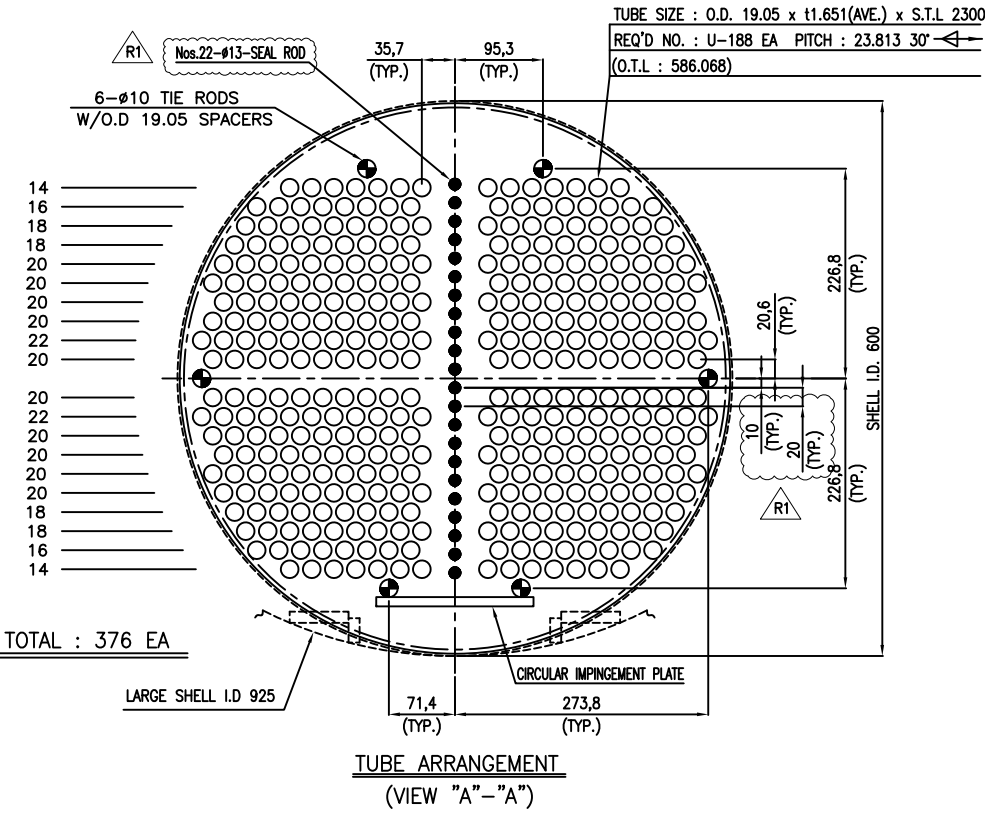

NOTES

1. UNLESS OTHERWISE NOTED ALL DIMENSIONS ARE IN MILLIMETERS.

\* FOR ONE SET

3	GUIDE RAIL	SA516-70N	2	t12 x 63.7 x 1412
2	GUIDE RAIL	SA516-70N	2	t12 x 26.4 x 1412
1	FULL SUPPORT	SA516-70	4	t10 x #595.2

BILL OF MATERIAL

REV.	ISSUE DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED
R1	07.13.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
RO	06.27.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.

CLIENT



مشاور مهندسی توسعه پارک صنعتی گوهر آفاق

CONSULTING ENGINEER

PROJECT: **STYRENE PARK OFFSITE**


DRAWING TITLE: **BUNDLE DETAIL DRAWING FOR CHILLER (EVAPORATOR) (1/2)**

DRAWING NO.	REV.	SIZE	SCALE	SHEET
EIO27-HSE-VD-ME-DWG-008	R1	A3	NTC	3 of 8

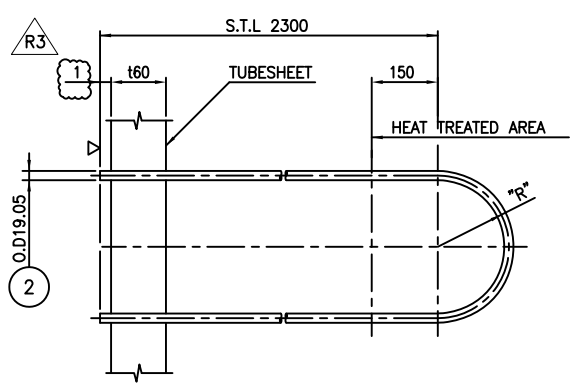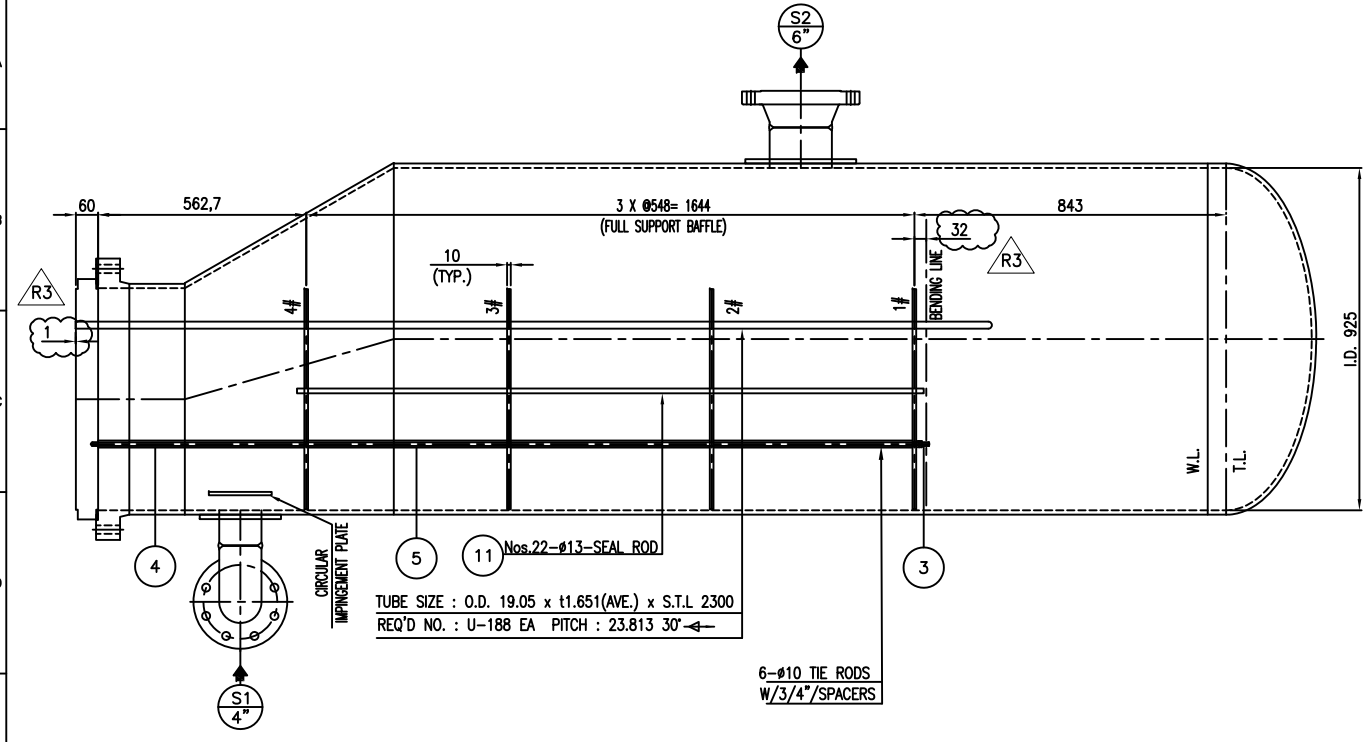


**U-TUBE**


NO.	"R"	"L"	Q'TY
1	35.72	4712.2	10
2	47.63	4749.6	10
3	59.53	4787.0	10
4	71.44	4824.4	10
5	83.35	4861.8	10
6	95.25	4899.3	10
7	107.16	4936.7	10
8	119.07	4974.1	10
9	130.98	5011.5	10
10	142.88	5048.9	10
11	154.79	5086.3	10
12	166.70	5123.7	10
13	178.60	5161.1	10
14	190.51	5198.5	10
15	202.42	5235.9	8
16	214.33	5273.3	10
17	226.23	5310.7	8
18	238.14	5348.1	8
19	250.05	5385.5	6
20	261.95	5422.9	6
21	273.86	5460.4	2

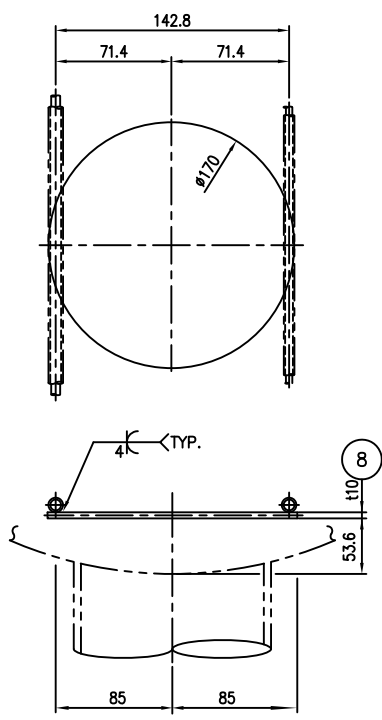


**IMPINGEMENT PLATE**

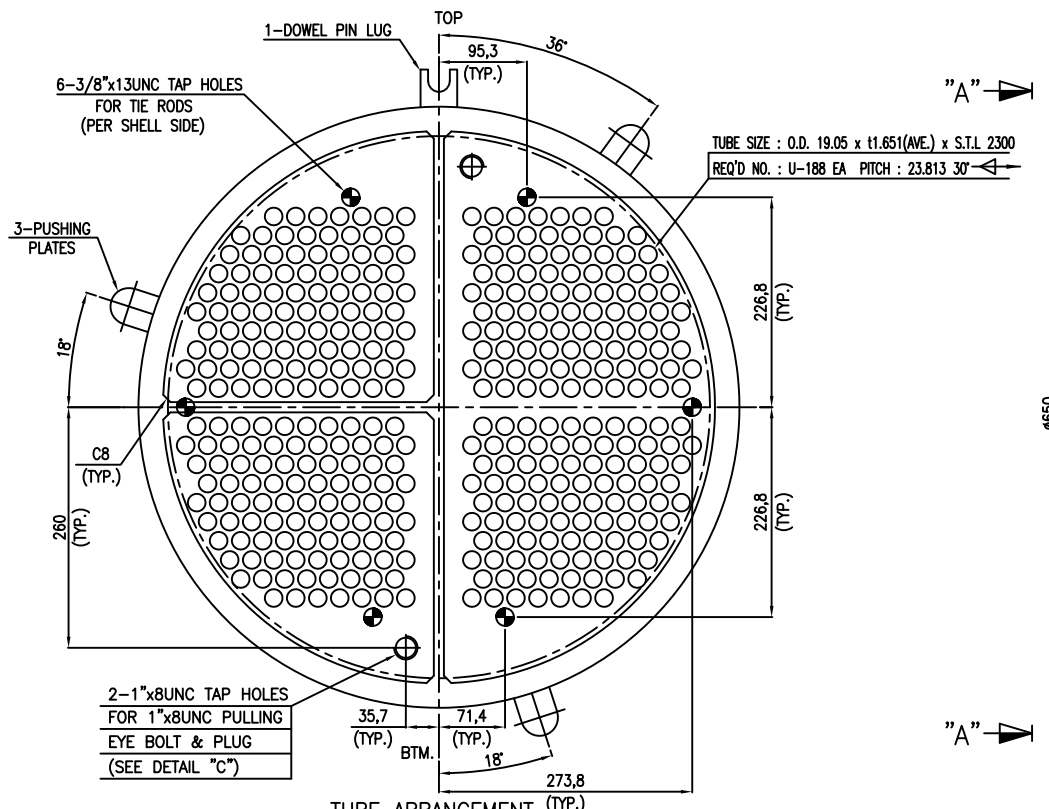


**TUBE ARRANGEMENT (VIEW "A"-"A")**

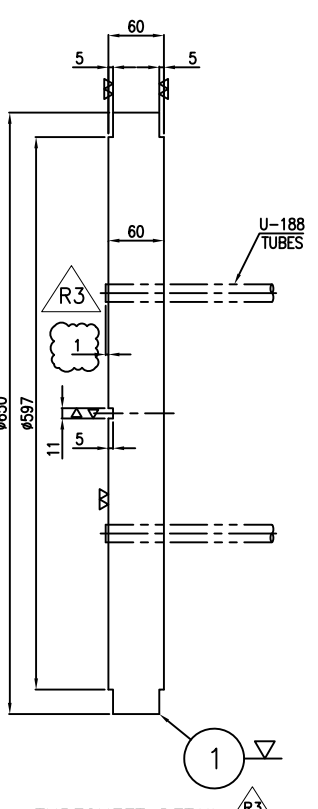

**TUBESHEET DETAIL**

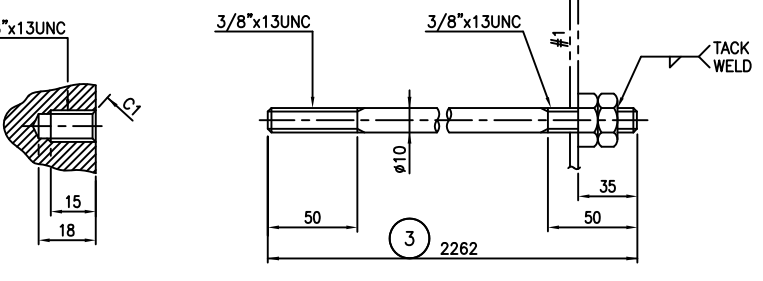

**TIE ROD & 2 NUTS**

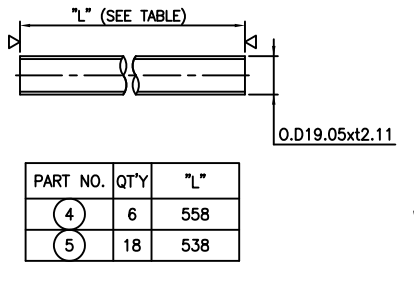


**SPACER**


PART NO.	QTY	"L"
4	6	558
5	18	538

**TUBE TO TUBESHEET JOINT**


**6 EYE BOLT**




**DETAIL "C"**




**7 PLUG**

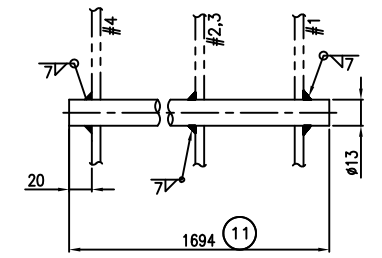

**SEALING ROD**

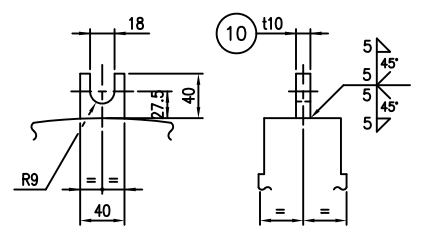

**DOWEL PIN LUG**

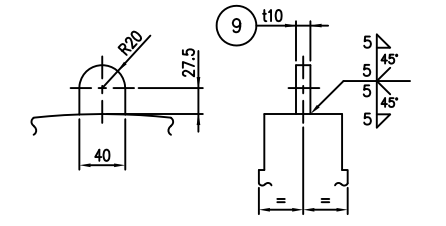

**PUSHING PLATE**

**NOTES**

1. UNLESS OTHERWISE NOTED ALL DIMENSIONS ARE IN MILLIMETERS.

\* FOR ONE SET

NO.	PART NAME	MATERIAL	REGULAR QUANTITY	SPARE QUANTITY	SPECIFICATION	REMARK
11	SEAL ROD	SA-36	22		R.B. #13, L=1694	
10	DOWEL PIN LUG	SA516-70N	1		t10 x 40 x 40	
9	PUSHING PLATE	SA283-C	3		t10 x 34 x 47.5	
8	IMPINGEMENT PLATE	SA516-70N	1		t10 x Ø170	
7	PLUG	304 S.S	2		1"x8UNC	
6	EYE BOLT	SA36	2		1"x8UNC	
5	SPACER	SA334-6	18		Ø19.05 x t1.651 x L538	
4	TIE ROD & 2NUTS	SA334-6	6		Ø19.05 x t1.651 x L538	
3	TIE ROD & 2NUTS	SA36/SA194-2H	6SETS		3/8"x13UNC (Ø10) x L282	
2	TUBE	SA334-6	U-188		Ø19.05 x t1.651 x S.L2300	
1	TUBESHEET	SA350-LF2 CLIN	1		160x Ø650	

**BILL OF MATERIAL**

REV.	ISSUE DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED
R3	04.20.2025	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R2	09.14.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R1	07.13.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R0	06.27.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.

CLIENT




پتروشیمی توسعه پارک  
صنعتی گوهر الماس

CONSULTING ENGINEER


PROJECT: **STYRENE PARK OFFSITE**

DRAWING TITLE: **BUNDLE DETAIL DRAWING FOR CHILLER (EVAPORATOR) (2/2)**


DRAWING NO.	REV.	SIZE	SCALE	SHEET
EIO27-HSE-VD-ME-DWG-008	R3	A3	NTC	4 of 8

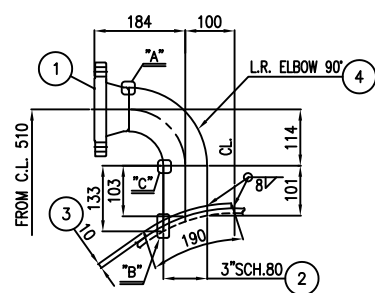


DETAIL OF T1 T2  
3\"/>

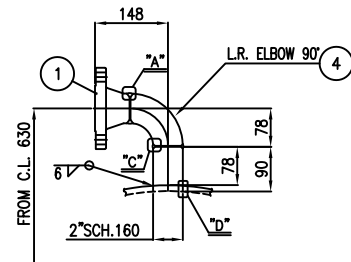


DETAIL OF D1 D2 S3  
2\"/>

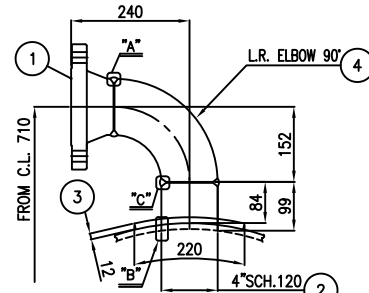


DETAIL OF S1  
4\"/>

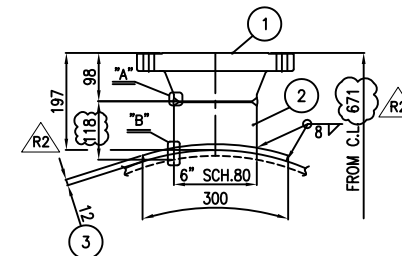


DETAIL OF S2  
6\"/>

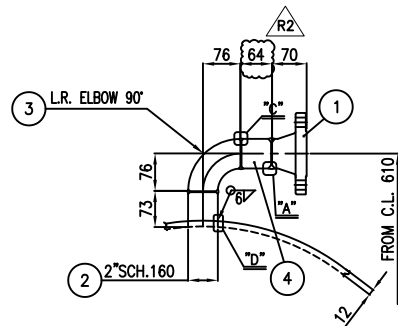


DETAIL OF LG1 LG2  
2\"/>



DETAIL OF PSV  
3\"/>



DETAIL OF V  
2\"/>

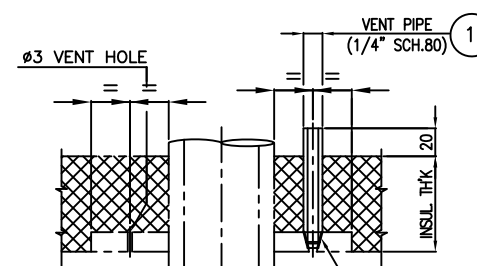

HOLES ON REINF. PAD  
(SEE NOTE 2,3)

**NOTES**  
 1. UNLESS OTHERWISE NOTED ALL DIMENSIONS ARE IN MILLIMETERS.  
 2. FOR THE TEST VENT HOLES #3 WILL BE OBTURED BY WELDING.  
 3. AFTER TEST 1/4\"/>

**BILL OF MATERIAL FOR ONE SET**

NOZZLE NO.	PART NO.	PART NAME	MATERIAL	REGULAR QUANTITY	SPARE QUANTITY	SPECIFICATION	REMARK
	2	HALF COUPLING	SA105	5		1/4\"/>	
	1	VENT PIPE	SA106-B	5		1/4\"/>	
	5	DELETED					
LG1	4	NOZZLE NECK	SA333-6	2		2\"/>	
LG2	3	ELBOW	SA420-WPL6	2		2\"/>	
	2	NOZZLE NECK	SA333-6	2		2\"/>	
	1	FLANGE (SCH.160)	SA350-LF2 CL.1N	2		2\"/>	
D1	3	ELBOW	SA420-WPL6	3		2\"/>	
D2	2	NOZZLE NECK	SA333-6	3		2\"/>	
S3	1	FLANGE (SCH.160)	SA350-LF2 CL.1N	3		2\"/>	
V	1	FLANGE (THK.16.6)	SA350-LF2 CL.1N	1		2\"/>	
	3	REINF. PAD	SA516-70N	1		t12 x #220	
S1	2	NOZZLE NECK	SA333-6	1		4\"/>	
	1	FLANGE (SCH.120)	SA350-LF2 CL.1N	1		4\"/>	
	3	REINF. PAD	SA516-70N	1		t12 x #190	
PSV	2	NOZZLE NECK	SA333-6	1		3\"/>	
	1	FLANGE (SCH.160)	SA350-LF2 CL.1N	1		3\"/>	
	3	REINF. PAD	SA516-70N	1		t12 x #300	
S2	2	NOZZLE NECK	SA333-6	1		6\"/>	
	1	FLANGE (SCH.80)	SA350-LF2 CL.1N	1		6\"/>	
	4	ELBOW	SA424-WPB	2		3\"/>	
T1	3	REINF. PAD	SA516-70N	2		t10 x #190	
T2	2	NOZZLE NECK	SA106-B	2		3\"/>	
	1	FLANGE (SCH.80)	SA105N	2		3\"/>	
	4	ELBOW	SA420-WPL6	1		4\"/>	
	3	REINF. PAD	SA516-70N	1		t12 x #225	
S1	2	NOZZLE NECK	SA333-6	1		4\"/>	
	1	FLANGE (SCH.120)	SA350-LF2 CL.1N	1		4\"/>	

**BILL OF MATERIAL**

REV.	ISSUE DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED
R2	11.10.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R1	09.14.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
RO	06.27.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.

CLIENT




پتروشیمی توسعه پارک  
صنعتی گوهر الماس

CONSULTING ENGINEER


PROJECT: **STYRENE PARK OFFSITE**

DRAWING TITLE: **NOZZLE DETAIL DRAWING FOR CHILLER (EVAPORATOR)**


DRAWING NO.	REV.	SIZE	SCALE	SHEET
EIO27-HSE-VD-ME-DWG-008	R2	A3	NTC	6 of 8




DETAIL "A"

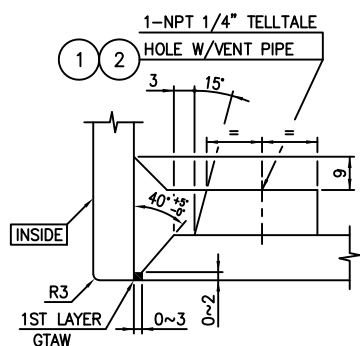

DETAIL "B"




DETAIL "C"

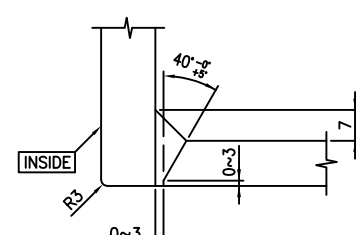


DETAIL "D"



"A"

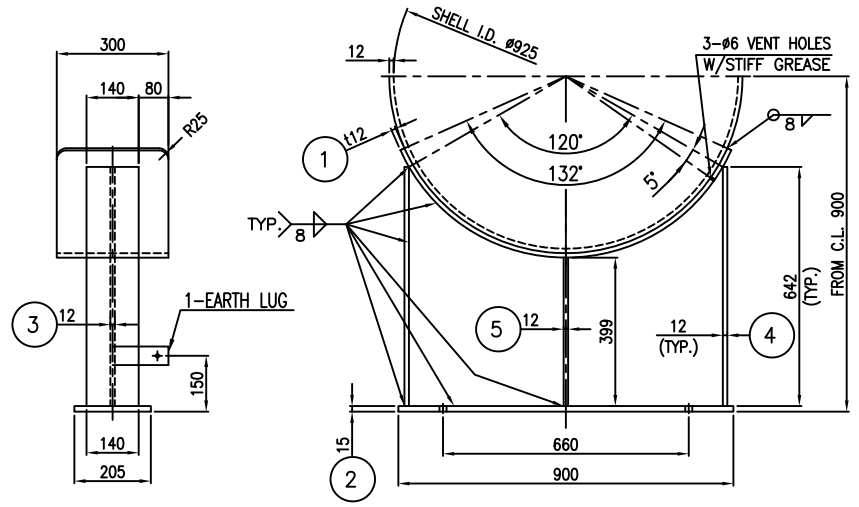



FIXED SIDE

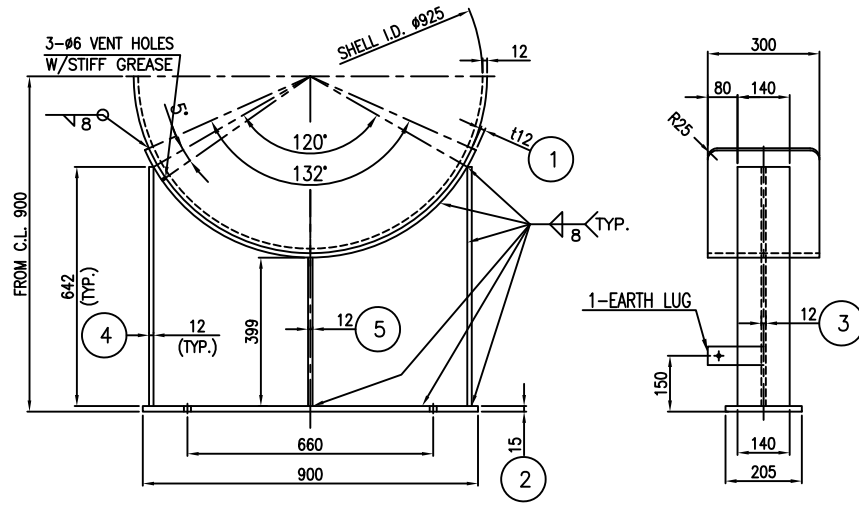


SLIDING SIDE

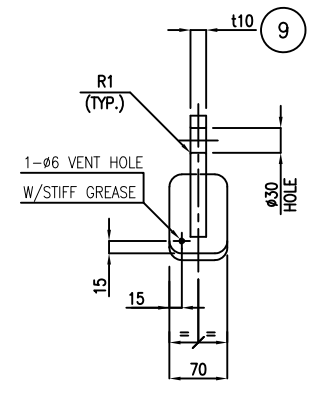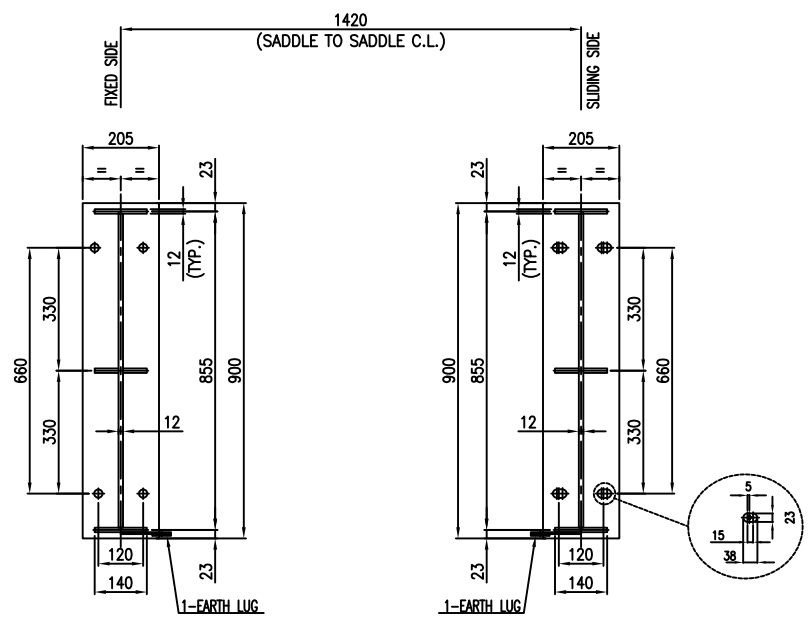


LIFTING LUG DETAIL  
(FOR CHANNEL SIDE)

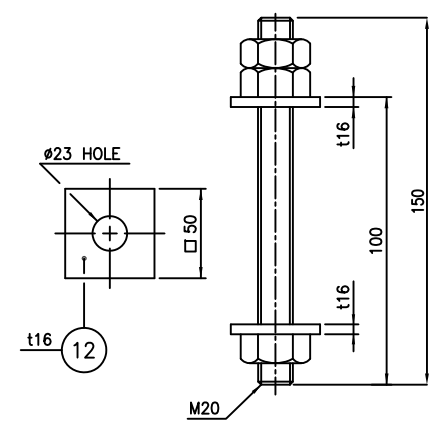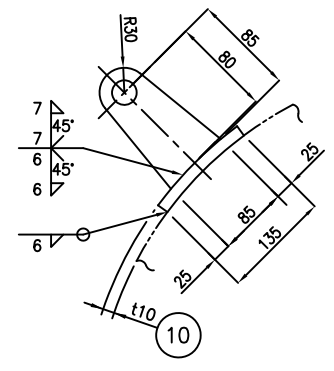

SETTING B/2NS/2W

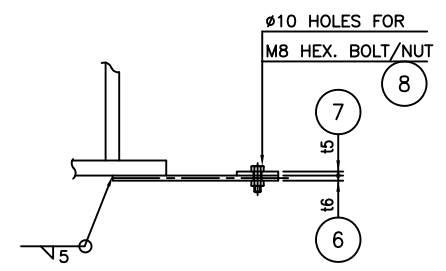

EARTH LUG

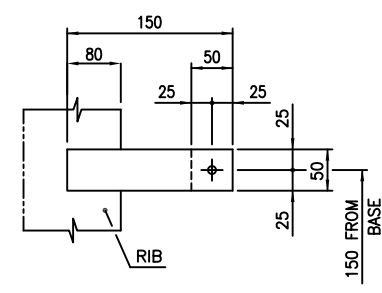

NOTES

- UNLESS OTHERWISE NOTED ALL DIMENSIONS ARE IN MILLIMETERS.
- SINCE CABLE LUG IS TINNED COPPER, TINNED CARBON STEEL EARTH LUG.

FOR ONE SET

PART NO.	PART NAME	MATERIAL	REGULAR QUANTITY	SPARE QUANTITY	SPECIFICATION	REMARK
12	WASHER	SA283-C	32		116 x 135 (NOT DP QLV)	
11	SETTING BOLT/2NUTS	SA193-B7/SA194-2H	8SETS		Ø20 x L150 (NOT DP QLV)	
10	REINF. PAD	SA516-70N	3		t12 x 70 x 135	
9	LIFTING LUG	SA283-C	3		t20 x 85 x 122	
8	HEX. BOLT/NUT	S.S. 304	2SETS		M8 x L25	
7	COPPER PLATE	SEE NOTE "2"	2		t5 x 50 x 150	
6	EARTH LUG	S.S. 304	2		t6 x 50 x 50	
5	SUPPORT RIB	SA283-C	4		t12 x 64 x 399	
4	SUPPORT RIB	SA283-C	4		t12 x 140 x 642	
3	WEB PLATE	SA283-C	2		t12 x 642 x 843	
2	BASE PLATE	SA283-C	2		t15 x 205 x 900	
1	WEAR PLATE	SA516-70N	2		t12 x 300 x 1107	

BILL OF MATERIAL

REV.	ISSUE DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED
R2	09.14.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R1	07.21.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
R0	06.27.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.

CLIENT




CONSULTING ENGINEER


PROJECT: **STYRENE PARK OFFSITE**

DRAWING TITLE: **SADDLE DETAIL DRAWING FOR CHILLER (EVAPORATOR)**


DRAWING NO.	REV.	SCALE	SHEET
E1027-HSE-VD-ME-DWG-008	R2	A3	5 of 8

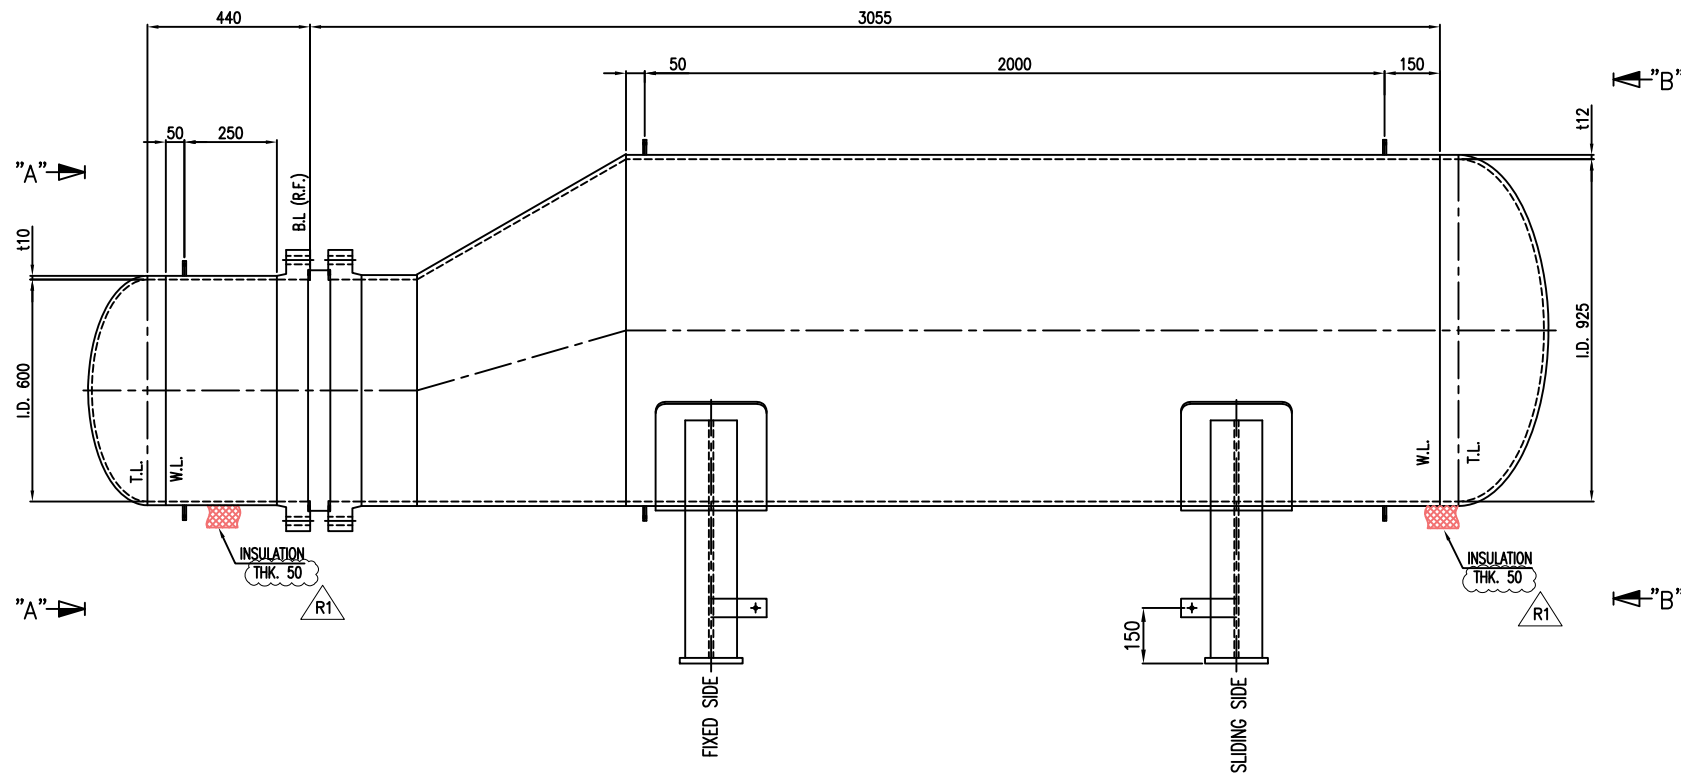


ELEVATION VIEW

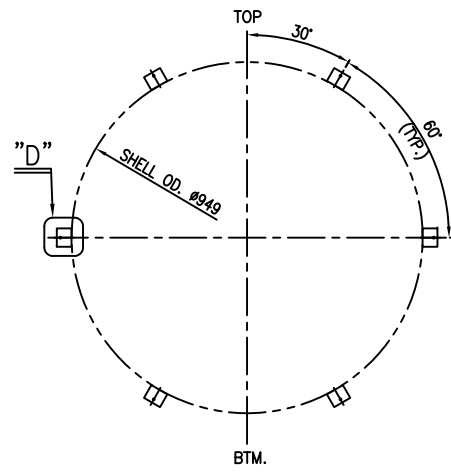

VIEW "B"-"B"

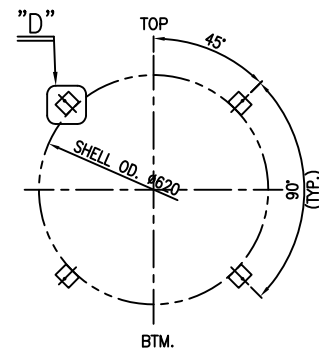

VIEW "A"-"A"

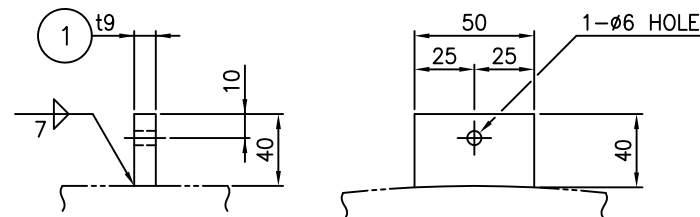

DETAIL "D"

**NOTES**

1. UNLESS OTHERWISE NOTED ALL DIMENSIONS ARE IN MILLIMETERS.

\* FOR ONE SET

PART NO.	PART NAME	MATERIAL	QUANTITY		SPECIFICATION	REMARK
			REGULAR	SPARE		
1	INSUL SUPT CLIP	SA516-70N	16		19 x 40 x 50	
<b>BILL OF MATERIAL</b>						
REV.	ISSUE DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED	
R1	10.18.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.	
RO	06.27.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.	

CLIENT




CONSULTING ENGINEER



PROJECT: **STYRENE PARK OFFSITE**

DRAWING TITLE: **INSULATION CLIP DRAWING FOR CHILLER (EVAPORATOR)**

DRAWING NO.	REV.	SIZE	SCALE	SHEET
EI027-HSE-VD-ME-DWG-008	R1	A3	NTC	7 of 8

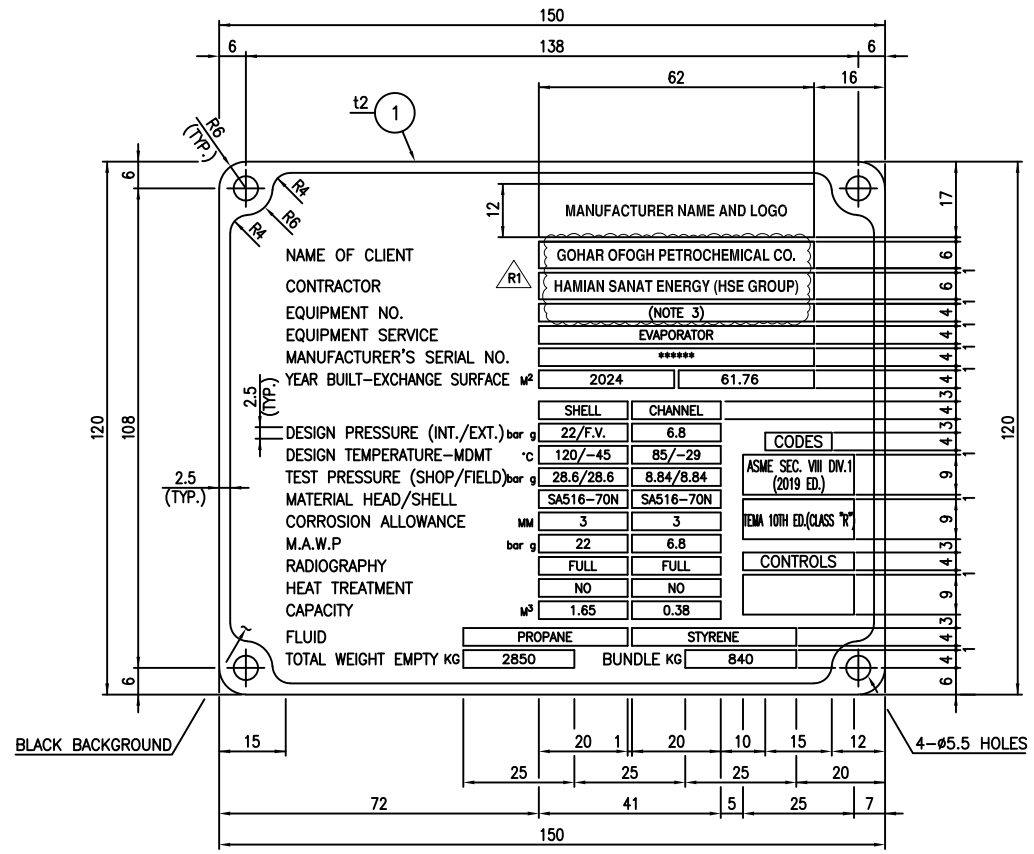

**NAME PLATE**

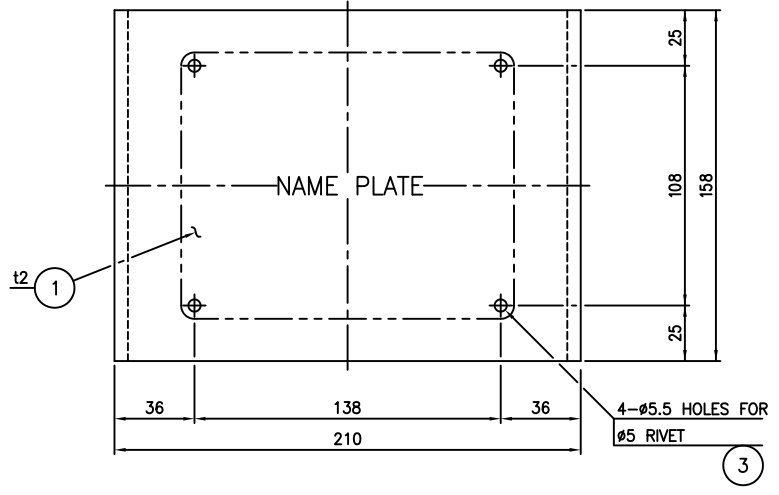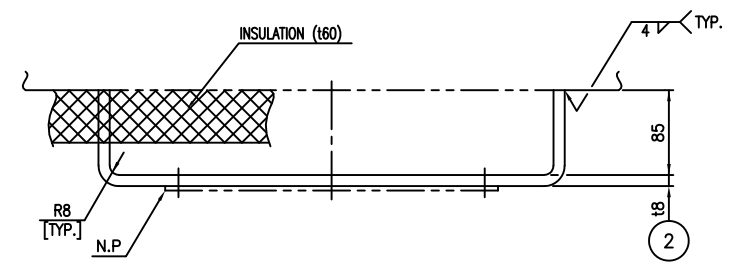

**NAME PLATE BRACKET**

- NOTES**
1. ALL LETTERS, BLOCKS, AS WELL AS EDGES, SHALL HAVE RAISED POLISHED FACE-RELIEF 0.5MM APPROX.
  2. LETTERS TO BE GOTHIC TYPE
  3. EACH NAME PLATE TO BE MARKED WITH ITS SPECIFIC ITEM NO.(RU00011A-E-02 AND RU00011B-E-02)

PART NO.	PART NAME	MATERIAL	REGULAR QUANTITY	SPARE QUANTITY	SPECIFICATION	REMARK
3	RIVET	COPPER	4		#5	
2	NAME PLATE BRACKET	SA516-70N	1		18 x 158 x 396	
1	NAME PLATE	304 S.S	1		12 x 120 x 150	

**BILL OF MATERIAL**

REV.	ISSUE DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED
R1	09.14.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.
RO	06.27.2024	ISSUED FOR APPROVAL (IFA)	D.SH.	M.O.	A.M.



CLIENT  
 CONSULTING ENGINEER  
 PROJECT: **STYRENE PARK OFFSITE**  
 DRAWING TITLE: **NAME PLATE DRAWING FOR CHILLER (EVAPORATOR)**

DRAWING NO.	REV.	SIZE	SCALE	SHEET
EIO27-HSE-VD-ME-DWG-008	R1	A3	NTC	8 of 8